

EF8


ECH2

EF9

EBC3

EL6

EZ4

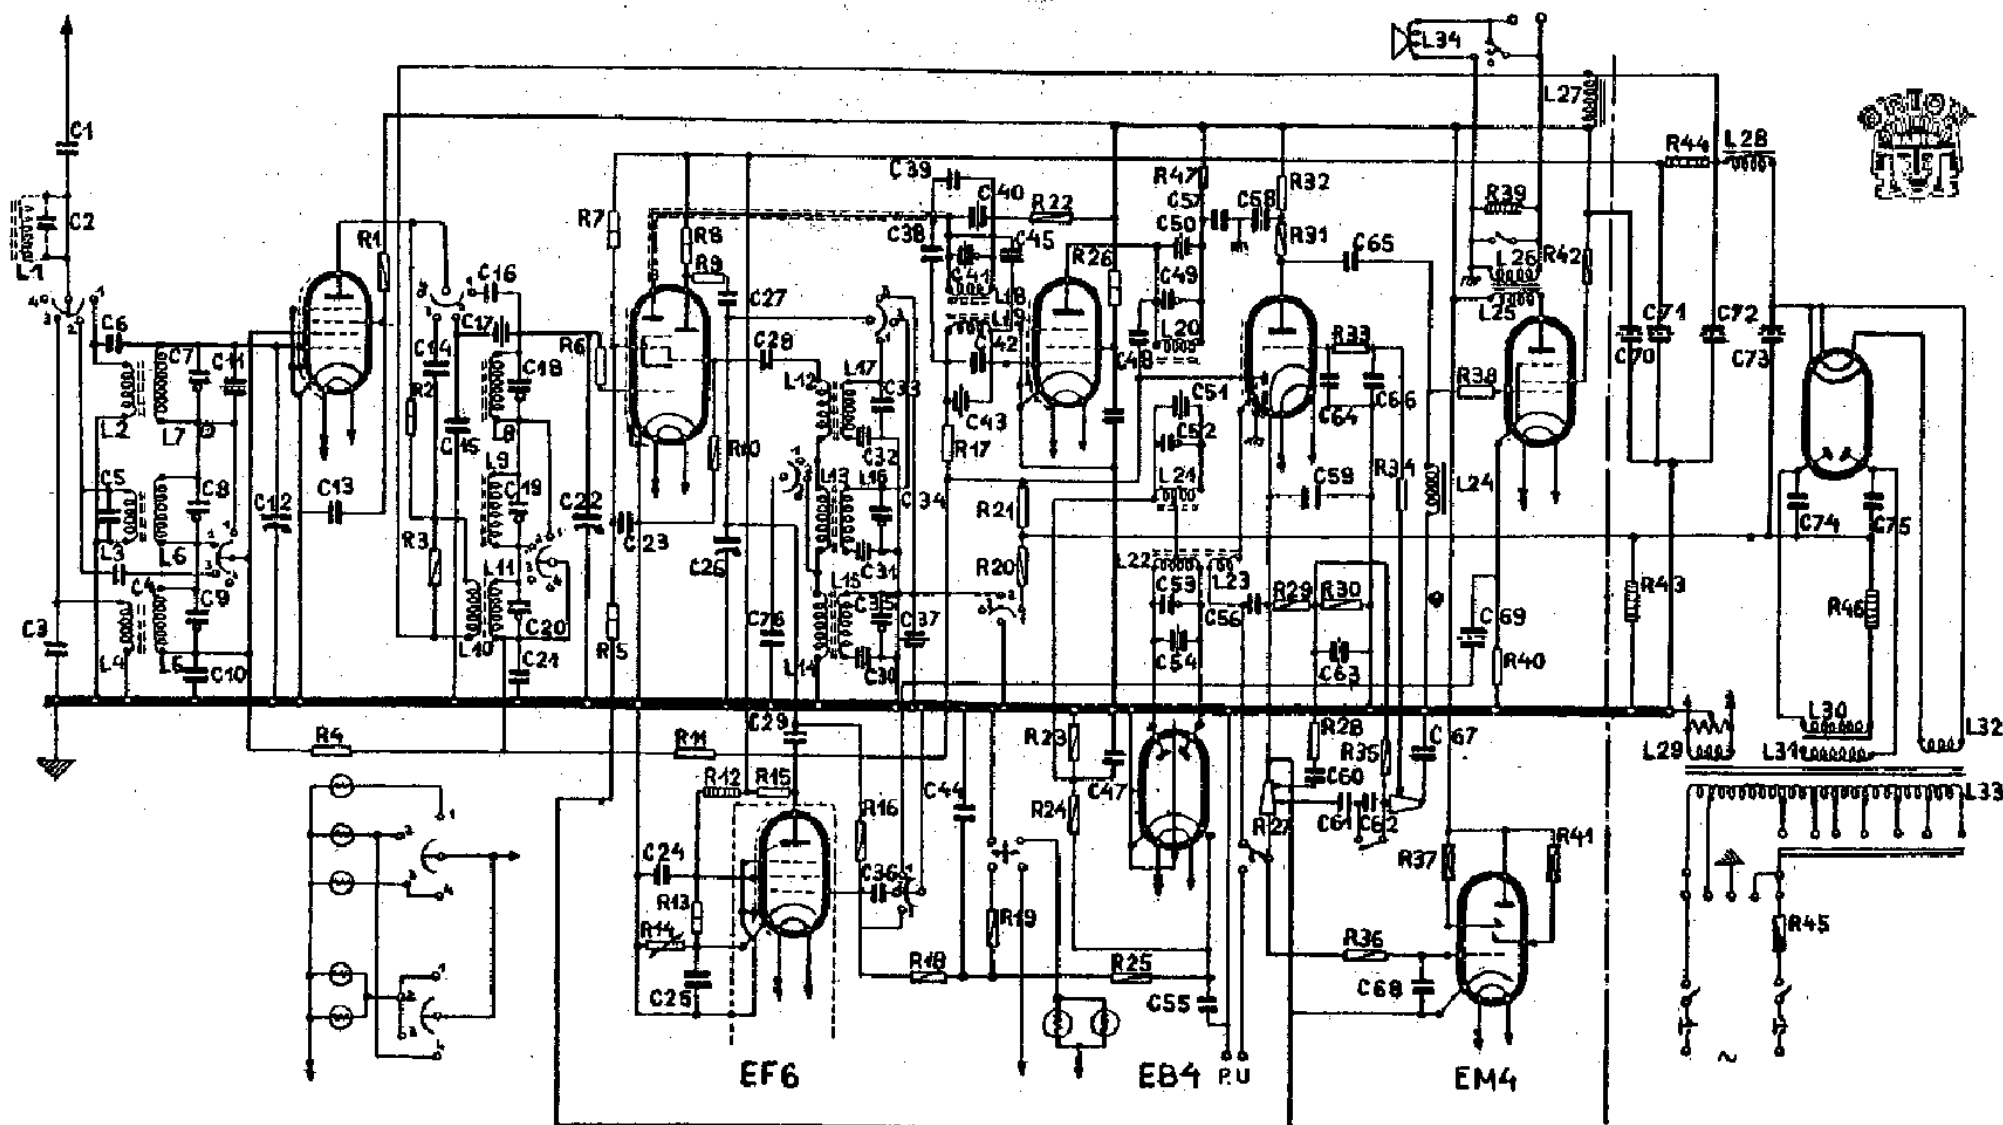

ZF : 473,6

ORION
069

C. 1.	Block 2 Kpf. 1500 V.	3046 N 40
C. 2.		
C. 3.	Block 100 Pf 1500 V.	3046 N 10
C. 4.	" 10 Kpf. 1500 V.	3046 N 47
C. 5.	Glimm-Block 35 Pf. + 10%	3049 N 12
C. 6.	" 5 Pf. + 10%	3049 N 5
C. 7.	Ausgleichkondensator 4 - 28 Pf.	
C. 8.	" 4 - 28 Pf.	
C. 9.	" 4 - 28 Pf.	
C. 10.	Block 50 Kpf. 750 V.	3045 N 59
C. 11.	Glimm-Block 10 Pf + 10%	3045 N 7
C. 12.	Deckkondensator	
C. 13.	Block 0.1 MF 1500 V.	3046 N 62
C. 14.	" 500 Pf. 1500 V.	3046 N 25
C. 15.	" 200 Pf. 1500 V.	3046 N 14
C. 16.	" 500 Pf. 1500 V.	3046 N 25
C. 17.	Glimm-Block 5 Pf. + 10%	3049 N 5
C. 18.	Ausgleichkondensator 4 - 28 Pf	
C. 19.	" 4 - 28 Pf	
C. 20.	" 4 - 28 Pf.	
C. 21.	Block 50 Kpf. 750 V.	3045 N 59
C. 22.	Drehkondensator	
C. 23.	Block 0.1 MF 1500 V.	3046 N 62
C. 24.	" 50 Kpf. 1500 V.	3046 N 59
C. 25.	" 50 Kpf. 750 V.	3045 N 59
C. 26.	Drehkondensator	
C. 27.	Block 1 Kpf. 1500 V.	3046 N 30
C. 28.	" 50 Kpf. 1500 V.	3046 N 5
C. 29.	" 5 Kpf. 1500 V.	3053 N 45
C. 30.	Glimm-Block 178 Pf. + 1%	3049 N 49
C. 31.	" 365 Pf. + 2%	3049 N 34
C. 32.	" 6400 Pf. + 5%	3049 N 45
C. 33.	Ausgleichkondensator 4 - 28 Pf.	
C. 34.	" 4 - 28 Pf.	
C. 35.	" 4 - 28 Pf.	
C. 36.	Block 250 Pf. 1500 V.	3046 N 17
C. 37.	Glimm-Block 10 Pf. + 10%	3049 N 7
C. 38.	Block 0.1 Mf 750 V.	3045 N 62
C. 39.	" 0.1 Mf 1500 V.	3046 N 62
C. 40.	Glimm-Block 235 Pf. + 2%	3049 N 24
C. 41.	Ausgleichkondensator 4 - 28 Pf.	
C. 42.	" 4 - 28 Pf.	
C. 43.	Glimm-Block 235 Pf + 2%	3049 N 24
C. 44.	Block 20 Kpf. 1500 V.	3046 N 53
C. 45.	Glimm-Block 5 Pf + 10%	3049 N 5
C. 46.	Block 0.1 MF 1500 V.	3046 N 62
C. 47.	Block 100 Pf. 1500 V.	3046 N 10
C. 48.	Glimm-Block 20 Pf + 10%	3049 N 9
C. 49.	Ausgleichkondensator 4 - 28 Pf.	
C. 50.	Glimm-Block 235 Pf + 10%	3049 N 24
C. 51.	" 235 Pf + 10%	3049 N 24
C. 52.	Ausgleichkondensator 4 - 28	
C. 53.	" 4 - 28	
C. 54.	Glimm-Block 320 Pf. + 2%	3049 N 46
C. 55.	Block 20 Kpf. 1500 V.	3046 N 53
C. 56.	Block 100 Pf 1500 V.	3046 N 10
C. 57.	" 0.1 MF 1500 V.	3046 N 62
C. 58.	Elektrolyt-Block 4 MF 500/550 V.	3040 N 4
C. 59.	Elektrolyt-Block 25 MF 25 V.	3039 N 4



ORION
099

C. 61.	Block 20 Kpf. 1500 V.	3046 N 53
C. 62.	" 500 Pf. 1500 V.	3046 N 25
C. 63.	Elektrolyt-Block 25 MF 25 V.	3039 N 4
C. 64.	Block 100 Pf 1500 V.	3046 N 10
C. 65.	" 20 Kpf. 1500 V.	3046 N 53
C. 66.	" 100 Pf. 1500 V.	3046 N 10
C. 67.	" 500 Pf. 1500 V.	3046 N 25
C. 68.	" 50 Kpf. 750 V.	3046 N 59
C. 69.	Elektrolyt-Block 100 MF 10 V.	3039 N 6
C. 70.	Elektrolyt-Block 2x16 MF 500/550 V	3055 N 6
C. 71.	" " " " " "	3055 N 6
C. 72.	Elektrolyt-Block 2x16 MF 500/550 V.	3043 N 22
C. 73.	" " " " " "	3043 N 22
C. 74.	Block 50 Kpf. 3500 V.	3047 N 59
C. 75.	" 50 Kpf. 3500 V.	3047 N 59
C. 76.	" 2 Kpf. 1500 V.	3032 N 40
C. 77.	" 10 Kpf. 3500 V.	3054 N 47

R. 1.	Salit 10 K Ohm 0.5 W	3010 N 24
R. 2.	" 10 K Ohm 2 W	3012 N 19
R. 3.	" 1 K Ohm 0.5 W	3015 N 18
R. 4.	" 0.1 M Ohm 0.5 W.	3010 N 34
R. 5.	" 30 K Ohm 2 W.	3012 N 31
R. 6.	" 35 Ohm 0.25 W.	3009 N 3
R. 7.	" 14 K Ohm 2 W.	3018 N 36
R. 8.	" 20 K Ohm 2 W.	3012 N 21
R. 9.	" 35 Ohm 0.25 W.	3009 N 3
R. 10.	" 20 K Ohm 0.25 W.	3009 N 26
R. 11.	" 0.5 M Ohm 0.25 W.	3009 N 41
R. 12.	" 20 K Ohm 3 W.	3020 N 31
R. 13.	" 25 K Ohm 2 W.	3018 N 38
R. 14.	Drahtpotentiometer	B 4029
R. 15.	Salit 0.1 M Ohm 0.5 W.	3010 N 34
R. 16.	" 10 K Ohm 0.5 W.	3010 N 24
R. 17.	" 0.5 M Ohm 0.25 W.	3009 N 41
R. 18.	" 0.5 M Ohm 0.5 W.	3010 N 41
R. 19.	" 1 M Ohm 0.5 W.	3010 N 44
R. 20.	" 60 Ohm 0.5 W.	3015 N 59
R. 21.	" 1.5 M Ohm 0.25 W	3009 N 50
R. 22.	" 10 K Ohm 0.5 W.	3010 N 24
R. 23.	" 1 M Ohm 0.5 W.	3010 N 44
R. 24.	" 1 M Ohm 0.5 W.	3010 N 44
R. 25.	" 1 M Ohm 0.5 W.	3010 N 44
R. 26.	" 60 K Ohm 2 W.	3018 N 41
R. 27.	Potmeter 0.5 M Ohm	B 4015

R. 29.	Salit 500 Ohm 0.5 W.	3010 N 12
R. 30.	" 1.5 K Ohm 0.25 W.	3009 N 50
R. 31.	" 0.2 M Ohm 0.5 W.	3010 N 36
R. 32.	" 2 K Ohm 0.25 W.	3009 N 18
R. 33.	" 0.1 M Ohm 0.25 W	3009 N 35
R. 34.	" 0.1 M Ohm 0.25 W.	3009 N 35
R. 35.	" 0.1 M Ohm 0.5 W.	3010 N 34
R. 36.	" 2 M Ohm 0.5 W.	3010 N 46
R. 37.	" 2 M Ohm 1 W.	3011 N 42
R. 38.	" 1 K Ohm 0.25 W.	3009 N 16
R. 39.	" 50 Ohm 6 W.	3023 N 5
R. 40.	" 100 Ohm 2 W.	3018 N 9
R. 41.	" 2 M Ohm 1 W.	3011 N 42
R. 42.	" 50 Ohm 0.5 W.	3022 N 14
R. 43.	" 40 Ohm 6 W.	3022 N 12
R. 44.	" 6 K Ohm 6 W.	3022 N 55
R. 45.	Thermosicherung	B 6001
R. 46.	Salit 50 Ohm 6 W.	3023 N 5
R. 47.	" 10 K Ohm 0.5 W	3010 N 24
R. 48.	" 40 Ohm 3 W.	3019 N 4