


TABELLA DELLE TENSIONI APPLICATE

Valvola	VK	Vg 1	Vg 2	Vg 3-5	Vg 4	VA
6K7G	4		80	4		250
6A8G	—	3	160	80	—	250
6K7G	—		80	—		250
6Q7G	2	—				80
6V6G	12		250			230
EM1	2			25		250
5Y3G	330					

SCHEMA CON VALORI B. F.

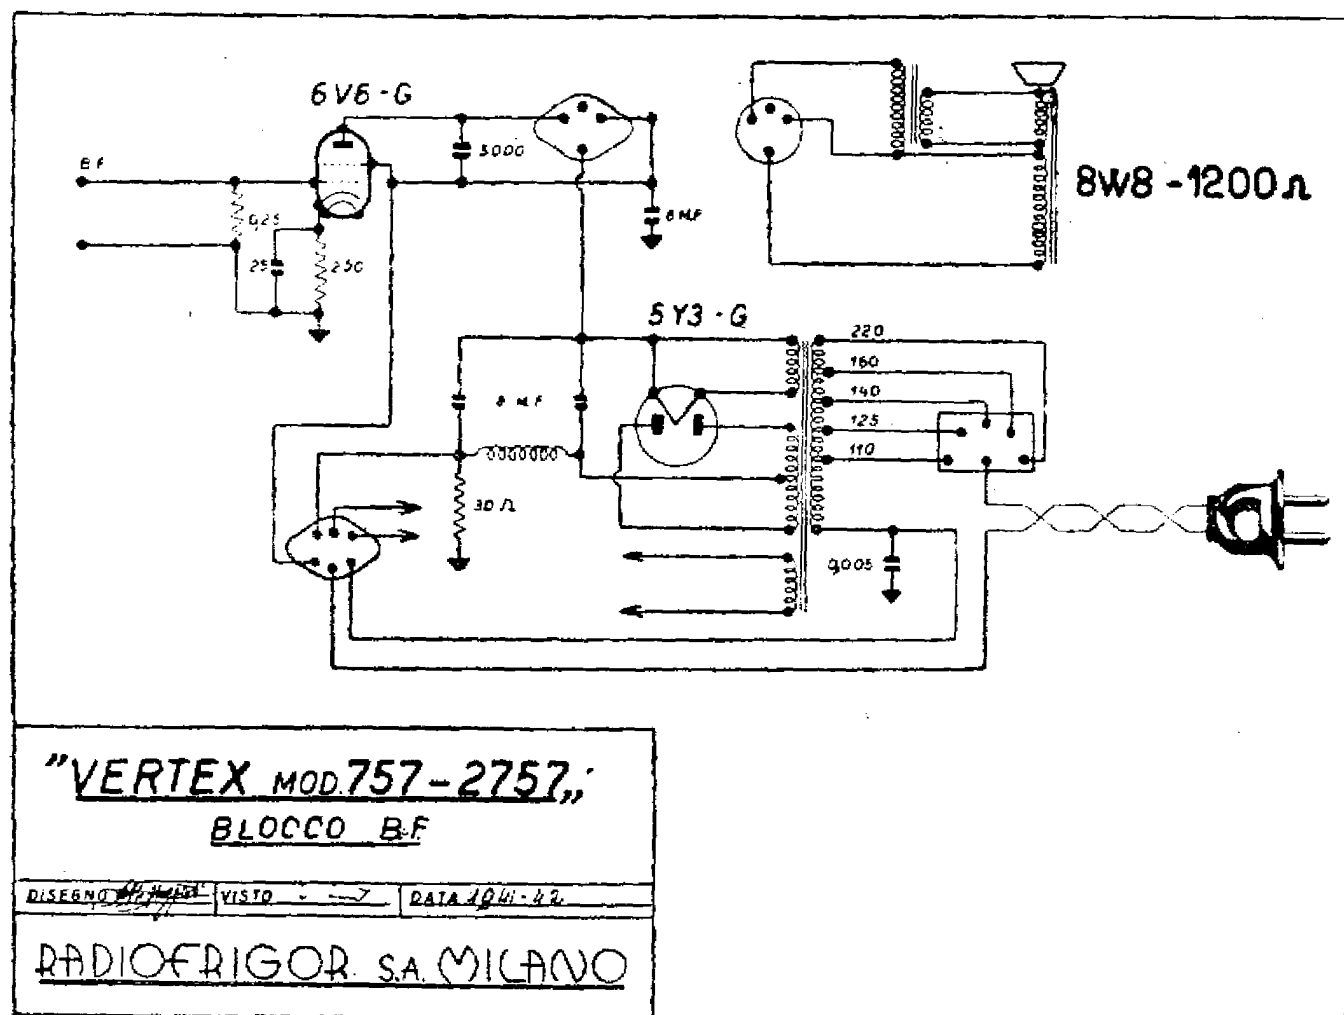

VERTEX (S. A. RADIOFRIGOR). — Mod. 757 e 2757. — Parte alimentatrice e amplificatrice, a seguito dello schema prec.