


## Wellenschalter Stellung 6

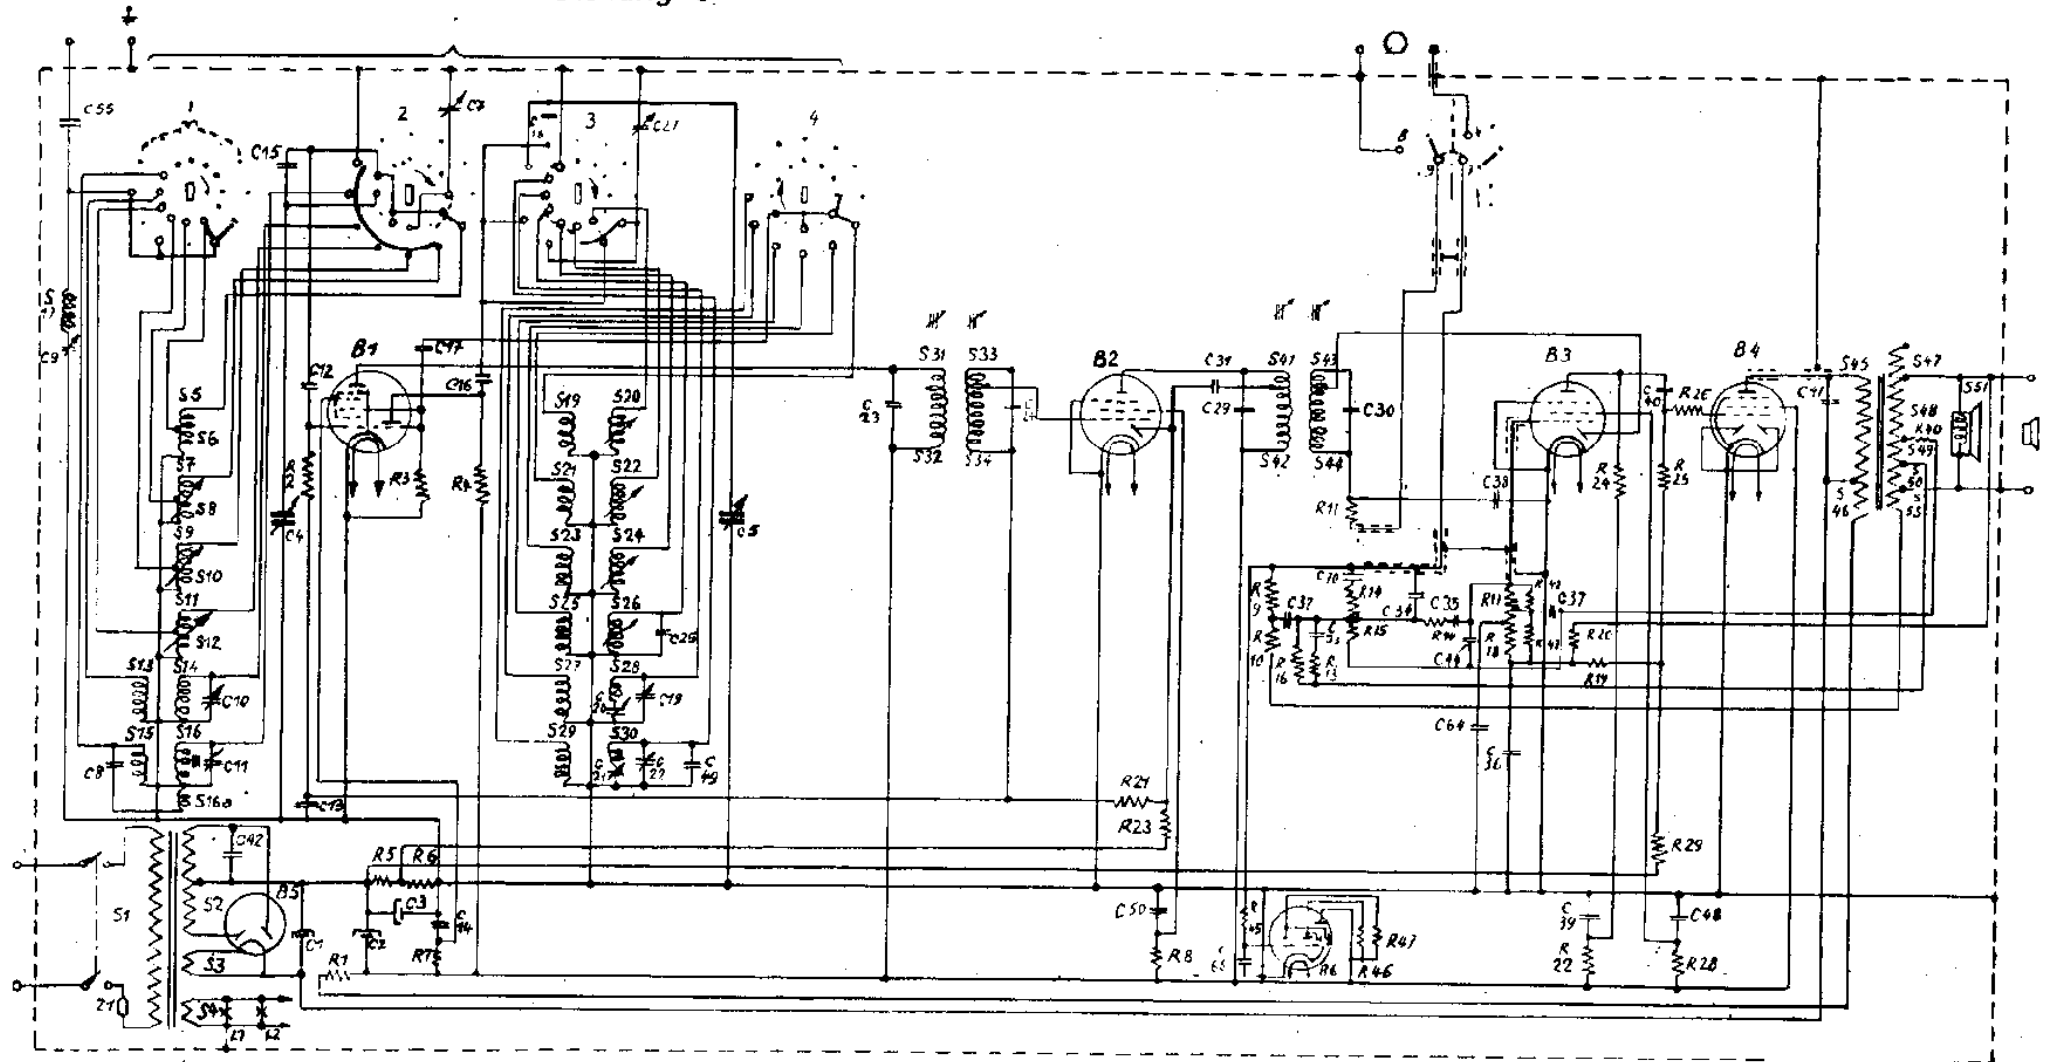


AZ1

ZF = 452 kHz

EM4

Bereiche: KW 6, 5, 4, 3, MW, LW

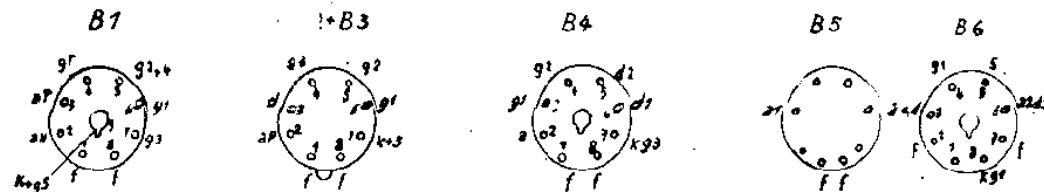

Jura 229

SPULEN			WIDERSTÄNDE				KONDENSATOREN			
Nr.	Wert	Kode-Nr.	Nr.	Wert	Watt	Kode-Nr.	Nr.	Kapazität	Toleranz max. Betriebsspannung	Kode-Nr.
S 1	45 $\Omega$	JK 051.76 125/145/220 V	R 1	1200 $\Omega$	3	48.468.10/1K2	C 1	50 $\mu$ F	Elko 355 V	48.317.09
S 2	330 $\Omega$		R 2	0,82 M $\Omega$	1/4	48.425.10/820 K	C 2	50 $\mu$ F		
S 3	0,1 $\Omega$		R 3	47000 $\Omega$	1/4	48.425.10/47 K	C 3	100 $\mu$ F		Elko 12,5 V 28.185.68
S 4	0,1 $\Omega$		R 4	22000 $\Omega$	1	48.427.10/22 K	C 4	12.492 pF	Drehko	A 9.863.18
S 5	0,16 $\Omega$	A 3.110.77	R 5	82 $\Omega$	1/2	48.428.05/82 E	C 5	12.492 pF		
S 6	0,16 $\Omega$		R 6	33 $\Omega$	1/4	48.425.10/33 E	C 7	30 pF	Lufttrimmer	28.212.36
S 7	0,18 $\Omega$	A 3.110.78	R 7	23500 $\Omega$	1	48.427.10/47 K	C 8	12 pF	Ker. $\pm 1$ pF	48.406.99/12 E
S 8	0,18 $\Omega$		R 8	0,1 M $\Omega$	1	48.427.10/100 K	C 9	30 pF	Lufttrimmer	28.212.36
S 9	0,38 $\Omega$	A 3.110.79	R 9	0,47 M $\Omega$	1/4	48.425.10/470 K	C 10	30 pF	Lufttrimmer	28.212.36
S 10	0,38 $\Omega$		R 10	18000 $\Omega$	1/4	48.425.10/18 K	C 11	30 pF	Lufttrimmer	28.212.36
S 11	0,75 $\Omega$	A 3.110.80	R 11	47000 $\Omega$	1/4	48.425.10/47 K	C 12	220 pF	20 %	48.408.20/220 E
S 12	0,75 $\Omega$		R 13	18000 $\Omega$	1/4	48.425.10/18 K	C 13	47000 pF	125 V 20 %	48.750.20/47 K
S 13	110 $\Omega$	A 3.122.20	R 14	0,65 M $\Omega$	Pot.	49.500.33	C 14	47000 pF	400 V 20 %	48.751.20/47 K
S 14	5 $\Omega$		R 15	2 M $\Omega$			C 15	115 pF	1 %	48.406.01/115 E
S 15	200 $\Omega$		R 16	0,1 M $\Omega$	1/4	48.425.10/100 K	C 16	470 pF	20 %	48.411.20/470 E
S 16	45 $\Omega$		R 17	2,2 M $\Omega$	Pot.	49.473.52	C 17	56 pF	10 %	48.406.10/56 E
S 16 a	6,5 $\Omega$	A 3.110.81	R 18	0,2 M $\Omega$			C 18	315 pF	$\pm 1$ pF	48.429.99/115 E
S 19	0,6 $\Omega$		R 19	0,82 M $\Omega$	1/4	48.425.10/820 K	C 19	30 pF	Lufttrimmer	28.212.36
S 20	0,2 $\Omega$		K 20	0,39 M $\Omega$	1/4	48.425.10/390 K	C 20	350-575 pF	Drucktrimmer	49.005.46
S 21	0,65 $\Omega$		R 21	1,5 M $\Omega$	1/2	48.426.10/1 M 5	C 21	200 pF	Drucktrimmer	28.212.08
S 22	0,22 $\Omega$	A 3.110.82	R 22	0,1 M $\Omega$	1/4	48.425.10/100 K	C 22	30 pF	Lufttrimmer	28.212.36
S 23	0,7 $\Omega$		R 23	1,5 M $\Omega$	1/2	48.426.10/1 M 5	C 25	4,7 pF	$\pm 1$ pF	48.406.99/4 E 7
S 24	0,55 $\Omega$	A 3.110.83	R 24	0,1 M $\Omega$	1/2	48.426.10/100 K	C 27	30 pF	Lufttrimmer	28.212.36
S 25	0,75 $\Omega$		R 25	0,56 M $\Omega$	1/4	48.425.10/560 K	C 31	18 pF	Ker. 10 %	48.406.10/18 E
S 26	0,75 $\Omega$	A 3.110.84	R 26	1000 $\Omega$	1/4	48.425.10/1 K	C 32	3300 pF	400 V 10 %	48.751.10/3 K 3
S 27	2,2 $\Omega$		R 28	0,68 M $\Omega$	1/4	48.426.10/680 K	C 33	8200 pF	125 V 10 %	48.750.10/8 K 2
S 28	6,5 $\Omega$	A 3.122.21	R 29	0,15 M $\Omega$	1/4	48.425.10/150 K	C 34	4,7 pF	Ker. $\pm 1$ pF	48.406.99/4 E 7
S 29	4,6 $\Omega$		R 40	1000 $\Omega$	1/4	48.425.10/1 K	C 35	8200 pF	125 V 10 %	48.750.10/8 K 2
S 30	19 $\Omega$		R 42	0,82 M $\Omega$	1/4	48.425.10/820 K	C 36	8200 pF	125 V 20 %	48.750.10/8 K 2
S 31	2,5 $\Omega$		R 43	3,3 M $\Omega$	1/2	48.426.10/3 M 3	C 37	100 pF	Ker. 10 %	48.406.10/100 E
S 32	4,5 $\Omega$	A 3.121.94	R 44	0,18 M $\Omega$	1/4	48.425.10/180 K	C 38	47 pF	Ker. 10 %	48.406.10/47 E
S 33	2,5 $\Omega$		R 45	2,2 M $\Omega$	1	48.427.10/2 M 2	C 39	0,1 $\mu$ F	400 V 20 %	48.751.20/100 K
S 34	4,5 $\Omega$		R 46	1 M $\Omega$	1/2	48.426.10/1 M	C 40	10000 pF	400 V 20 %	48.751.20/10 K
C 23	115 pF		R 47	1 M $\Omega$	1/2	48.426.10/1 M	C 41	2200 pF	800 V 20 %	48.757.20/2 K 2
C 24	115 pF	A 3.121.94					C 42	22000 pF	Spezial	48.756.20/22 K
S 41	2,5 $\Omega$						C 44	10 pF	Ker. 10 %	48.406.99/10 E
S 42	4,5 $\Omega$						C 48	47000 pF	400 V 20 %	48.751.20/47 K
S 43	2,5 $\Omega$						C 49	22 pF	Ker. 20 %	48.406.20/22 E
S 44	4,5 $\Omega$	A 3.151.47					C 50	47000 pF	400 V 20 %	48.751.20/47 K
C 29	115 pF						C 55	2200 pF	800 V 20 %	48.757.20/2 K 2
C 30	115 pF						C 64	68000 pF	125 V 20 %	48.750.20/68 K
S 45	750 $\Omega$						C 65	47000 pF	125 V 20 %	48.750.20/47 K
S 46	15 $\Omega$	A 3.110.60					C 70	10000 pF	800 V 20 %	48.757.20/10 K
S 47	0,05 $\Omega$									
S 48	0,6 $\Omega$									
S 49	0,05 $\Omega$									
S 50	0,05 $\Omega$	28.220.51								
S 51	1 $\Omega$									

## Ströme und Spannungen

Röhrentype		$U_a$	$U_{g2(4)}$	$I_a$	$I_{g2(4)}$	$I_k$
ECH 21 (B 1)	Heptode Triode	230 145	90	4,5 5	6	15,5
EA F 41 (B 2)	ZF	230	80	4	1	5
EA F 41 (B 3)	NF	55	35	0,85	0,3	1,2
EBL 21 (B 4)		270	230	30	4	34
		230		3		3
		Volt	Volt	mA	mA	mA

$U_{c1} = 270$  V  $U_{c2} = 230$  V  $U_{R5} = 5,5$  V  $U_{R6} = 1,5$  V  $I_{R1} = 25$  mA  $I_{tot.} = 56$  mA

Leistungsaufnahme: 50 Watt

Die Messungen wurden mit einem Messinstrument ausgeführt, dessen Innen-Widerstand 1000  $\Omega$  Volt beträgt